



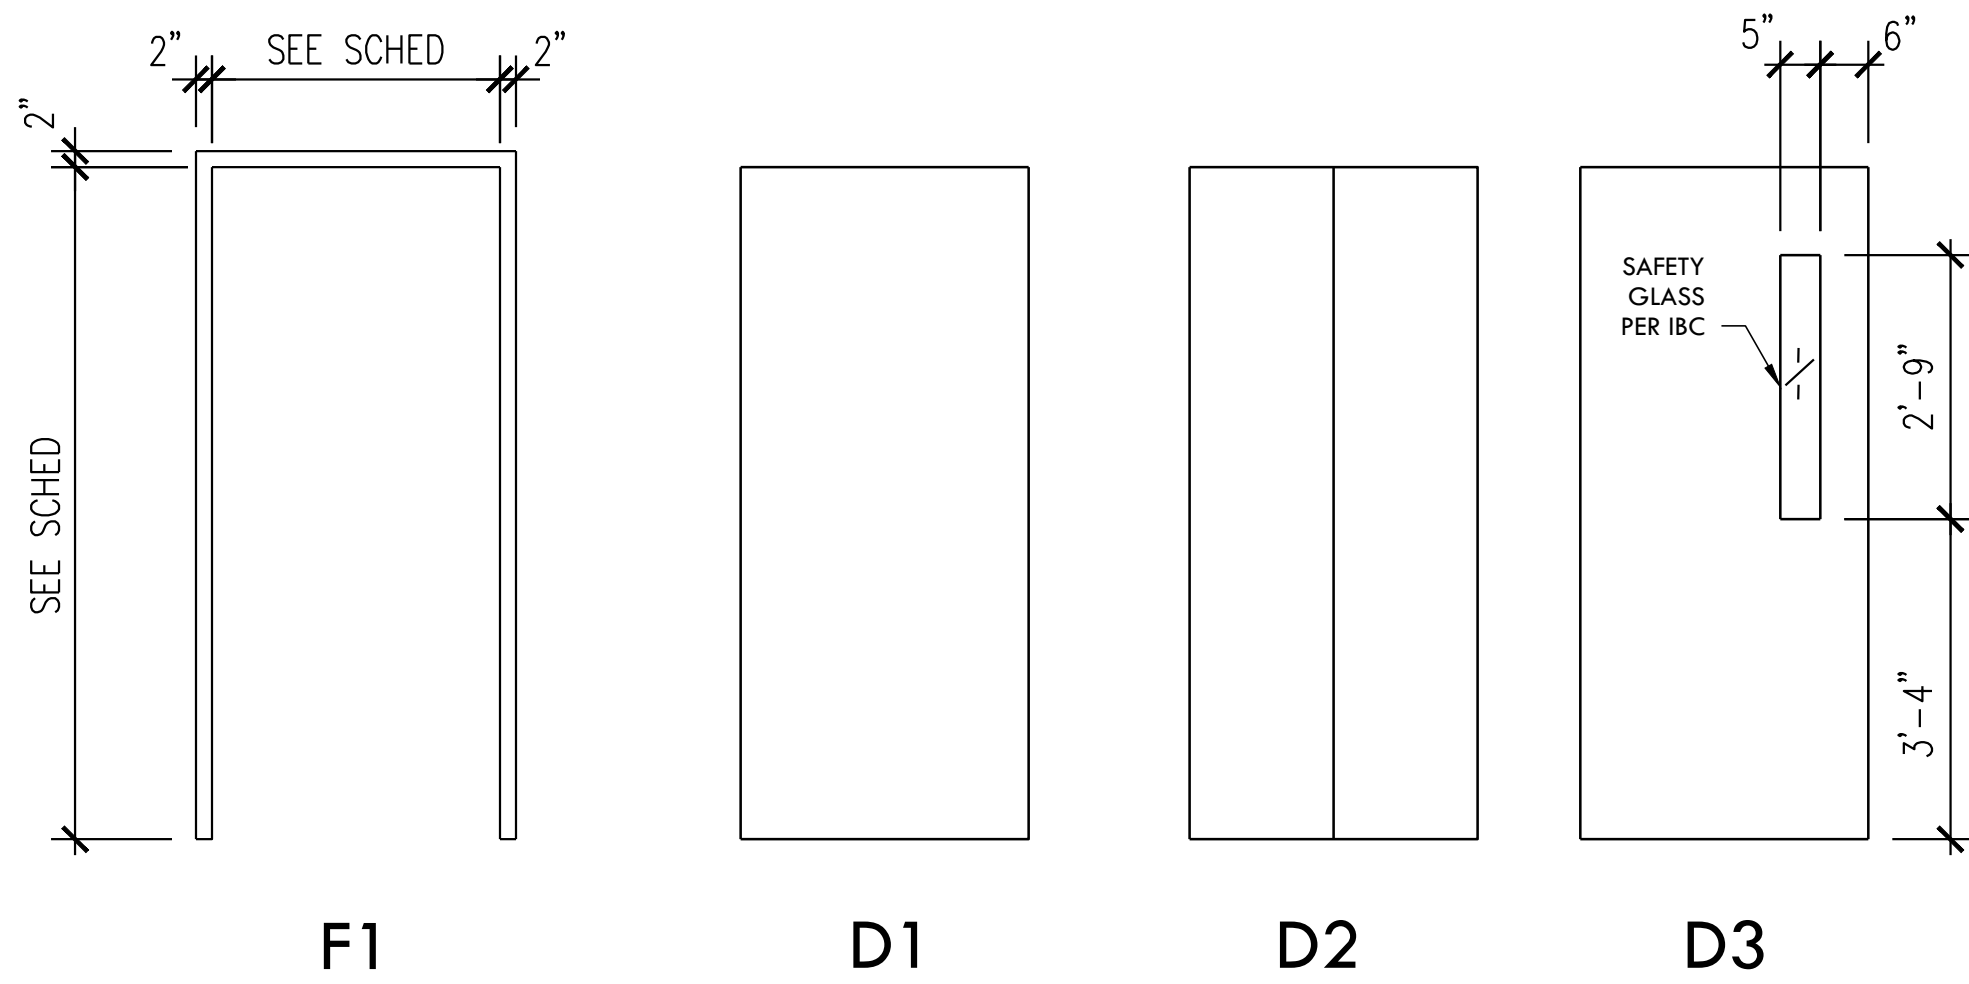



1 HOUR RATED WALL ASSEMBLY PARTITION TYPE 1			
GA FILE NO. WP 3644	GENERIC	1 HOUR FIRE	35 TO 39 STC SOUND
GYPSUM WALL BOARD, WOOD STUDS, MINERAL FIBER INSULATION			
ONE LAYER 5/8" TYPE X GYPSUM WALLBOARD APPLIED AT RIGHT ANGLES TO EACH SIDE OF 2 x 4 WOOD STUDS 16" O.C. WITH 2 1/4" TYPE S OR W DRYWALL SCREWS 12" O.C. 3 1/2" MINERAL FIBER INSULATION, NOMINAL 2.5 POF, FRICTION FIT IN STUD SPACE.		THICKNESS: 4-7/8" APPROX. WEIGHT: 7 1/2 PSF FIRE TEST: ITS J20-06170.1, 4-00	
VERTICAL JOINTS STAGGERED 16" O.C., HORIZONTAL JOINTS STAGGERED 24" O.C., ON OPPOSITE SIDES. TESTED AT 2,578 LBS PER STUD OR 100 PERCENT OF DESIGN LOAD. (LOAD BEARING)		FIELD SOUND TEST: NGC 2404, 10-14-70	

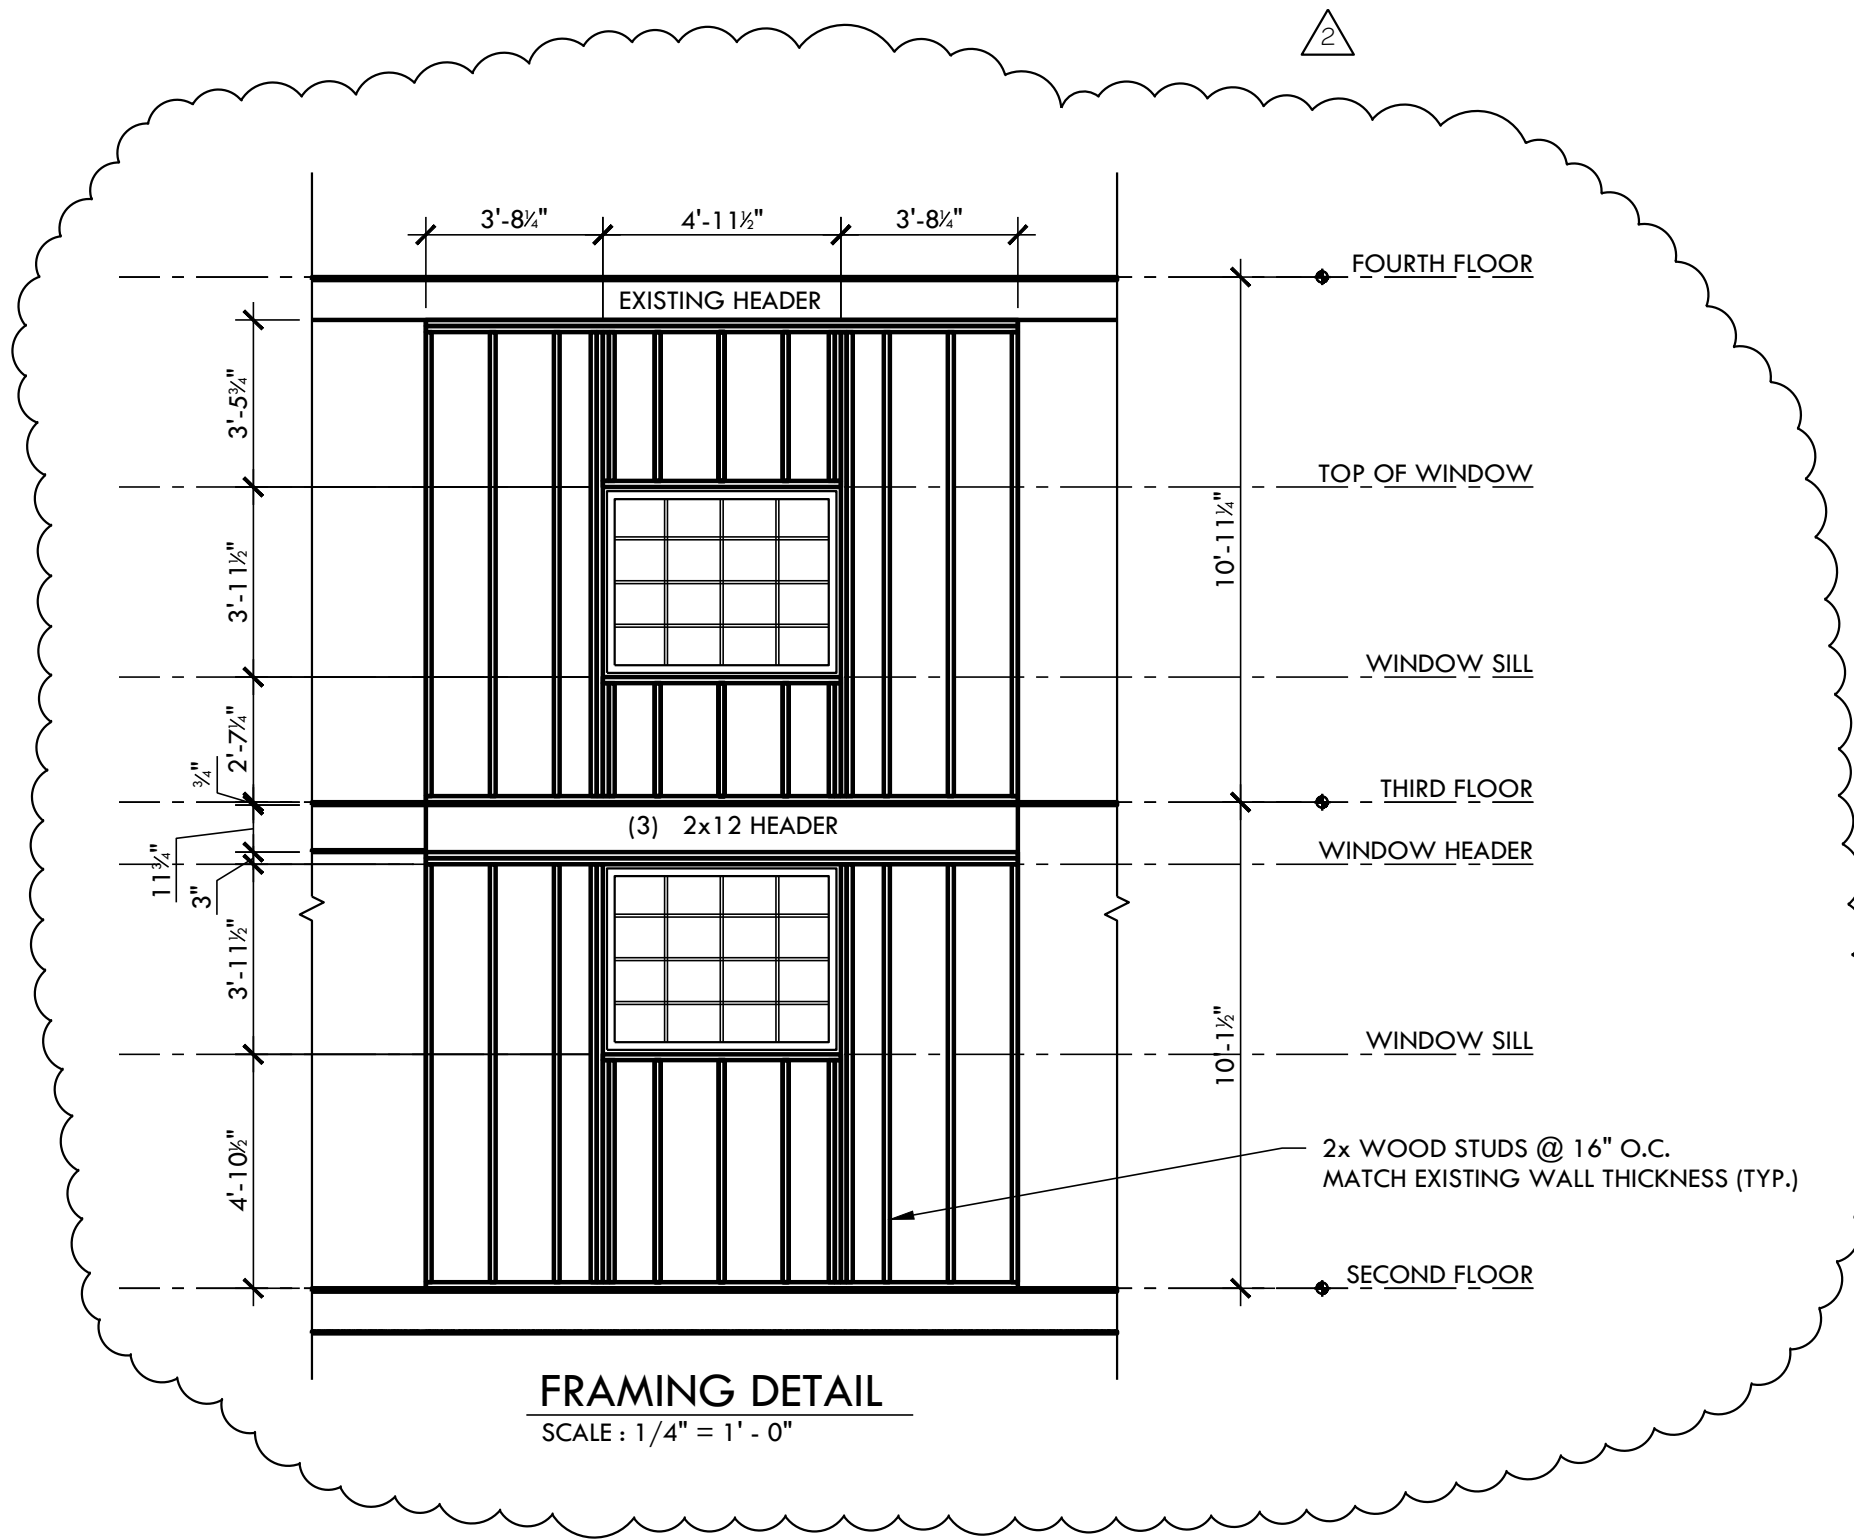

DOOR & FRAME SCHEDULE															
MK	ROOM TYPE	DOOR DATA						LABEL & RATING	FRAME DATA						REMARKS
		TYPE	MATL	FIN	GLASS	SIZE			TYPE	MATL	FIN	DETAILS			
						W	HGT					HEAD	JAMB	SILL	
A	UNIT ENTRANCE	D1	WOOD	STAIN	-	3-0	6-8	B-90	F1	STEEL	PAINT	H2	J2	-	DOOR CLOSER
B	BEDROOM	D1	WOOD	STAIN	-	2-6	6-8	-	F1	WOOD	PAINT	H1	J1	-	
C	BATHROOM	D1	WOOD	STAIN	-	2-4	6-8	-	F1	WOOD	PAINT	H1	J1	-	
D	MECHANICAL ROOM	D1	WOOD	STAIN	-	(2) 3-0	6-8	-	F1	WOOD	PAINT	H1	J1	-	BI-FOLD DOOR
E	BEDROOM CLOSET	D1	WOOD	STAIN	-	2-4	6-8	-	F1	WOOD	PAINT	H1	J1	-	BI-FOLD DOOR
F	LAUNDRY ROOM	D2	WOOD	STAIN	-	2-8	6-8	-	F1	WOOD	PAINT	H1	J1	-	BI-FOLD DOOR
G	ADA BATHROOM	D1	WOOD	STAIN	-	3-0	6-8	-	F1	WOOD	PAINT	H1	J1	-	
H	BEDROOM CLOSET	D1	WOOD	STAIN	-	4-0	6-8	-	F1	WOOD	PAINT	H1	J1	-	BI-FOLD DOOR
J	BEDROOM CLOSET	D1	WOOD	STAIN	-	6-0	6-8	-	F1	WOOD	PAINT	H1	J1	-	BI-FOLD DOOR
K	CLOSET	D1	WOOD	STAIN	-	2-6	6-8	-	F1	WOOD	PAINT	H1	J1	-	
L	ELEVATOR EQUIPMENT	D1	STEEL	PAINT	-	3-0	6-8	B-90	F1	STEEL	PAINT	H2	J2	-	DOOR CLOSER


DOOR HARDWARE REQUIREMENTS, (INCLUDING, BUT NOT LIMITED TO: CLOSERS, PUSH BARS, PULL BARS, KICK PLATES, PANIC BARS & LOCKING DEVICES) AS DETERMINED BY CODE AND OWNER SHALL BE PROVIDED BY DOOR MANUFACTURED & HARDWARE SUPPLIER. MAX. THRESHOLD HEIGHT = 1/2" TYPICAL.

FRSG - FIRE-RATED SAFETY GLASS

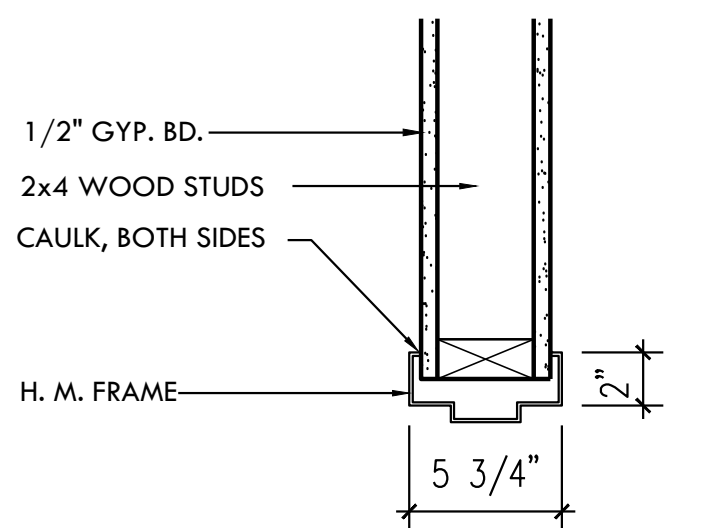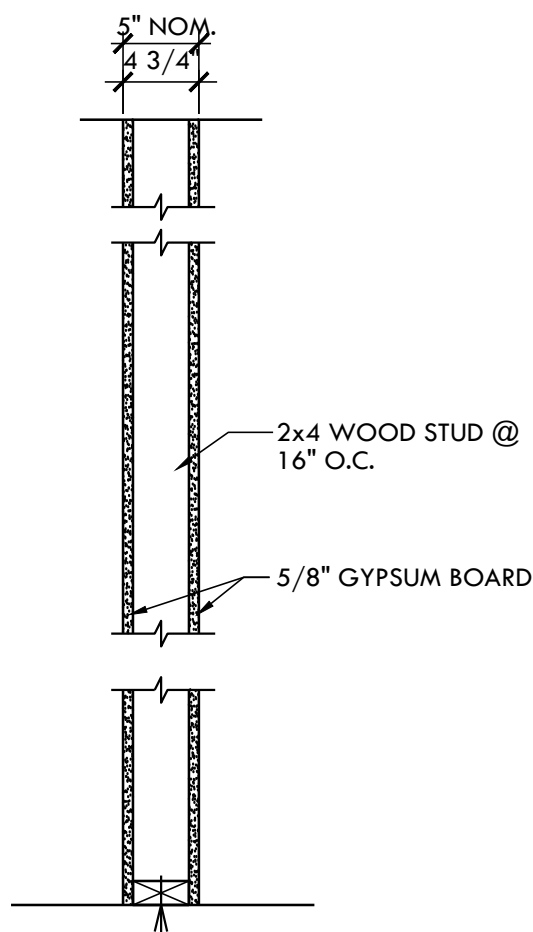


SEE PLANS & PARTITION TYPES FOR FIRE RATINGS AND LOCATIONS OF SOUND ATTENUATION

H1

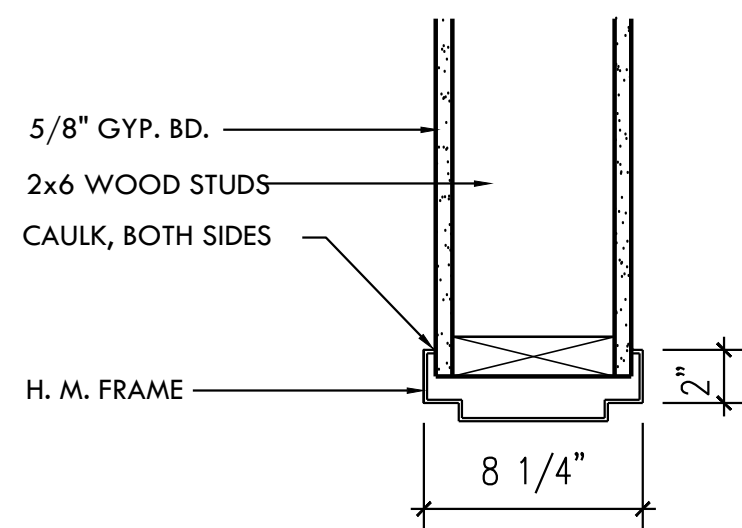


SEE PLANS & PARTITION TYPES FOR FIRE RATINGS AND LOCATIONS OF SOUND ATTENUATION

H2

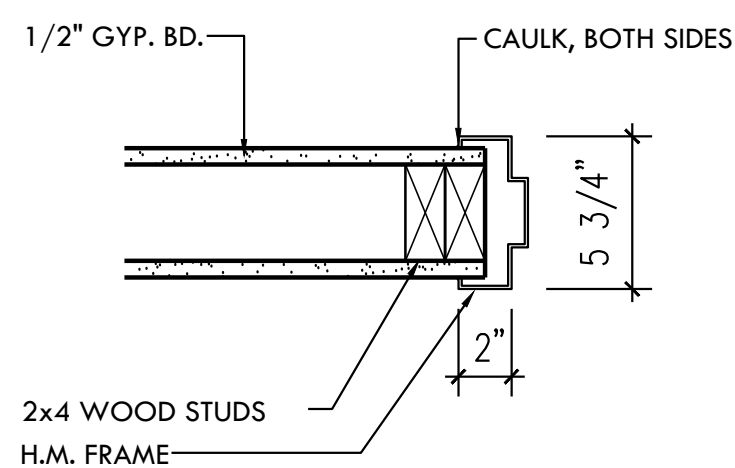


SEE PLANS & PARTITION TYPES FOR FIRE RATINGS AND LOCATIONS OF SOUND ATTENUATION


J1

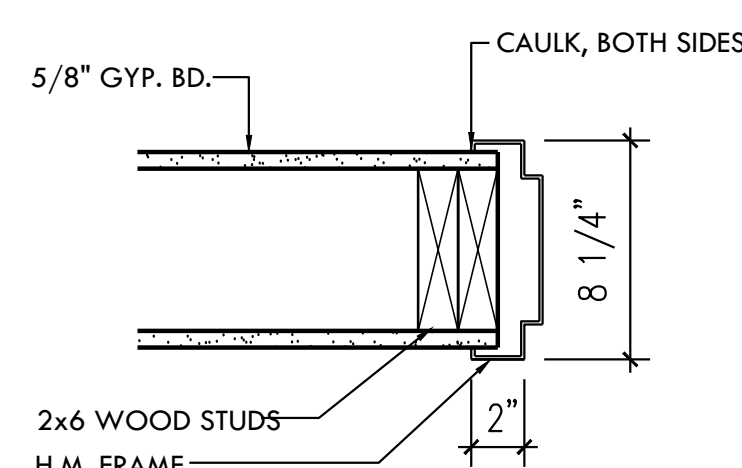

SEE PLANS & PARTITION TYPES FOR FIRE RATINGS AND LOCATIONS OF SOUND ATTENUATION

J2

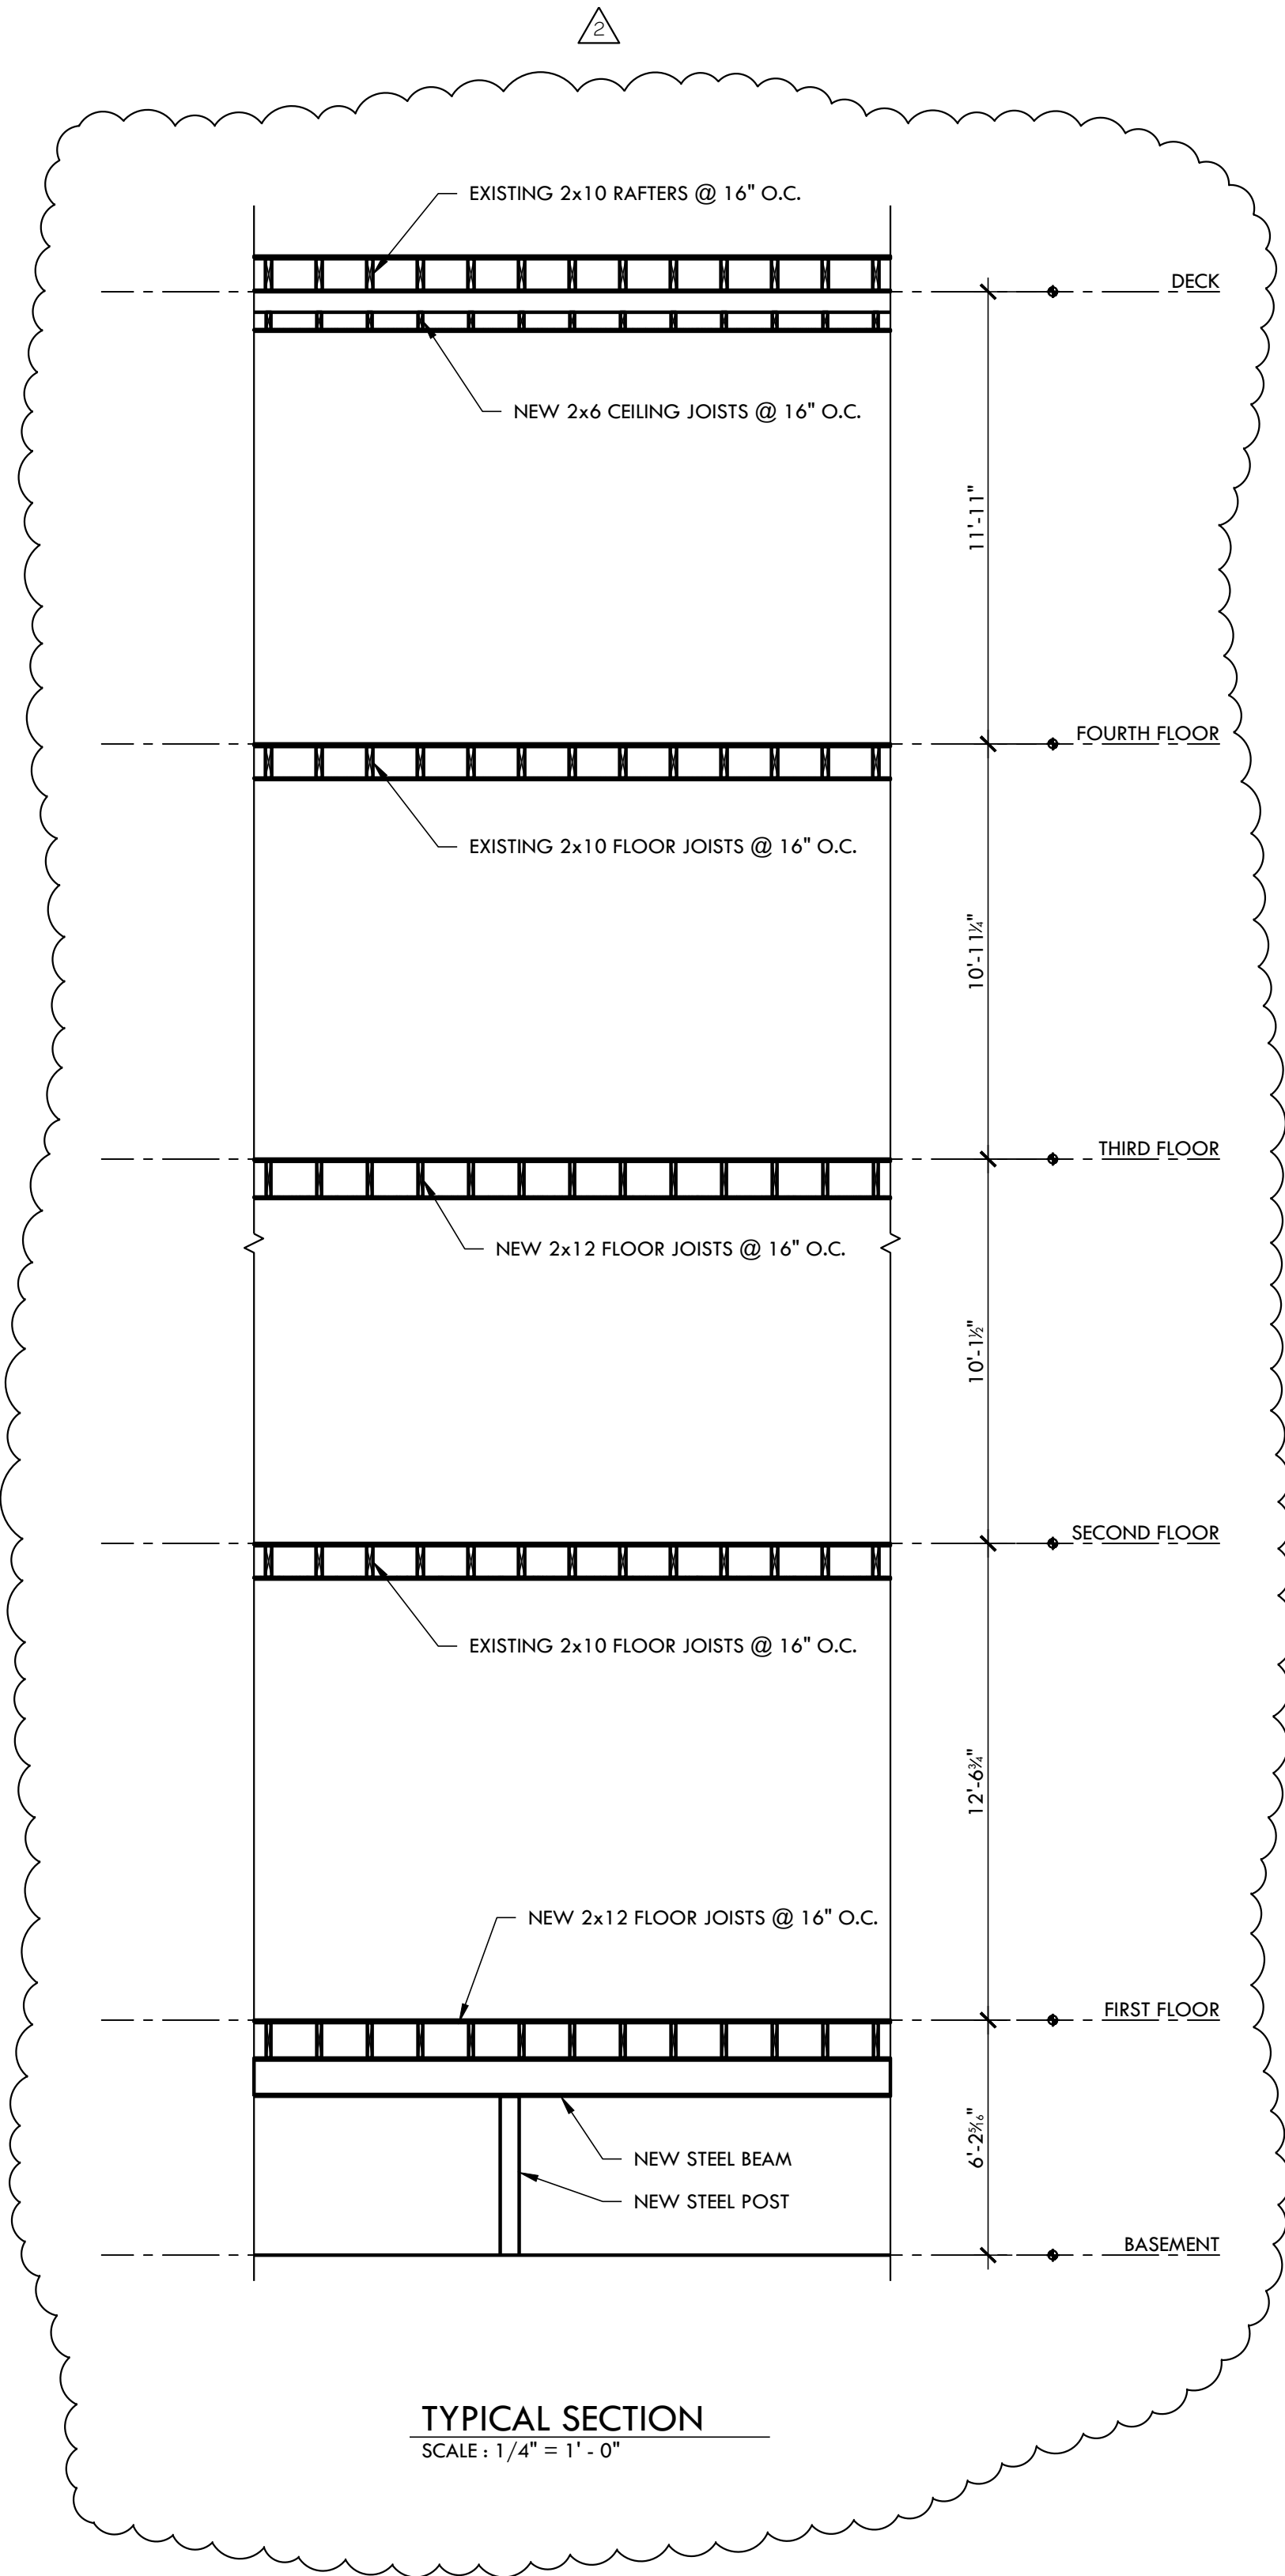

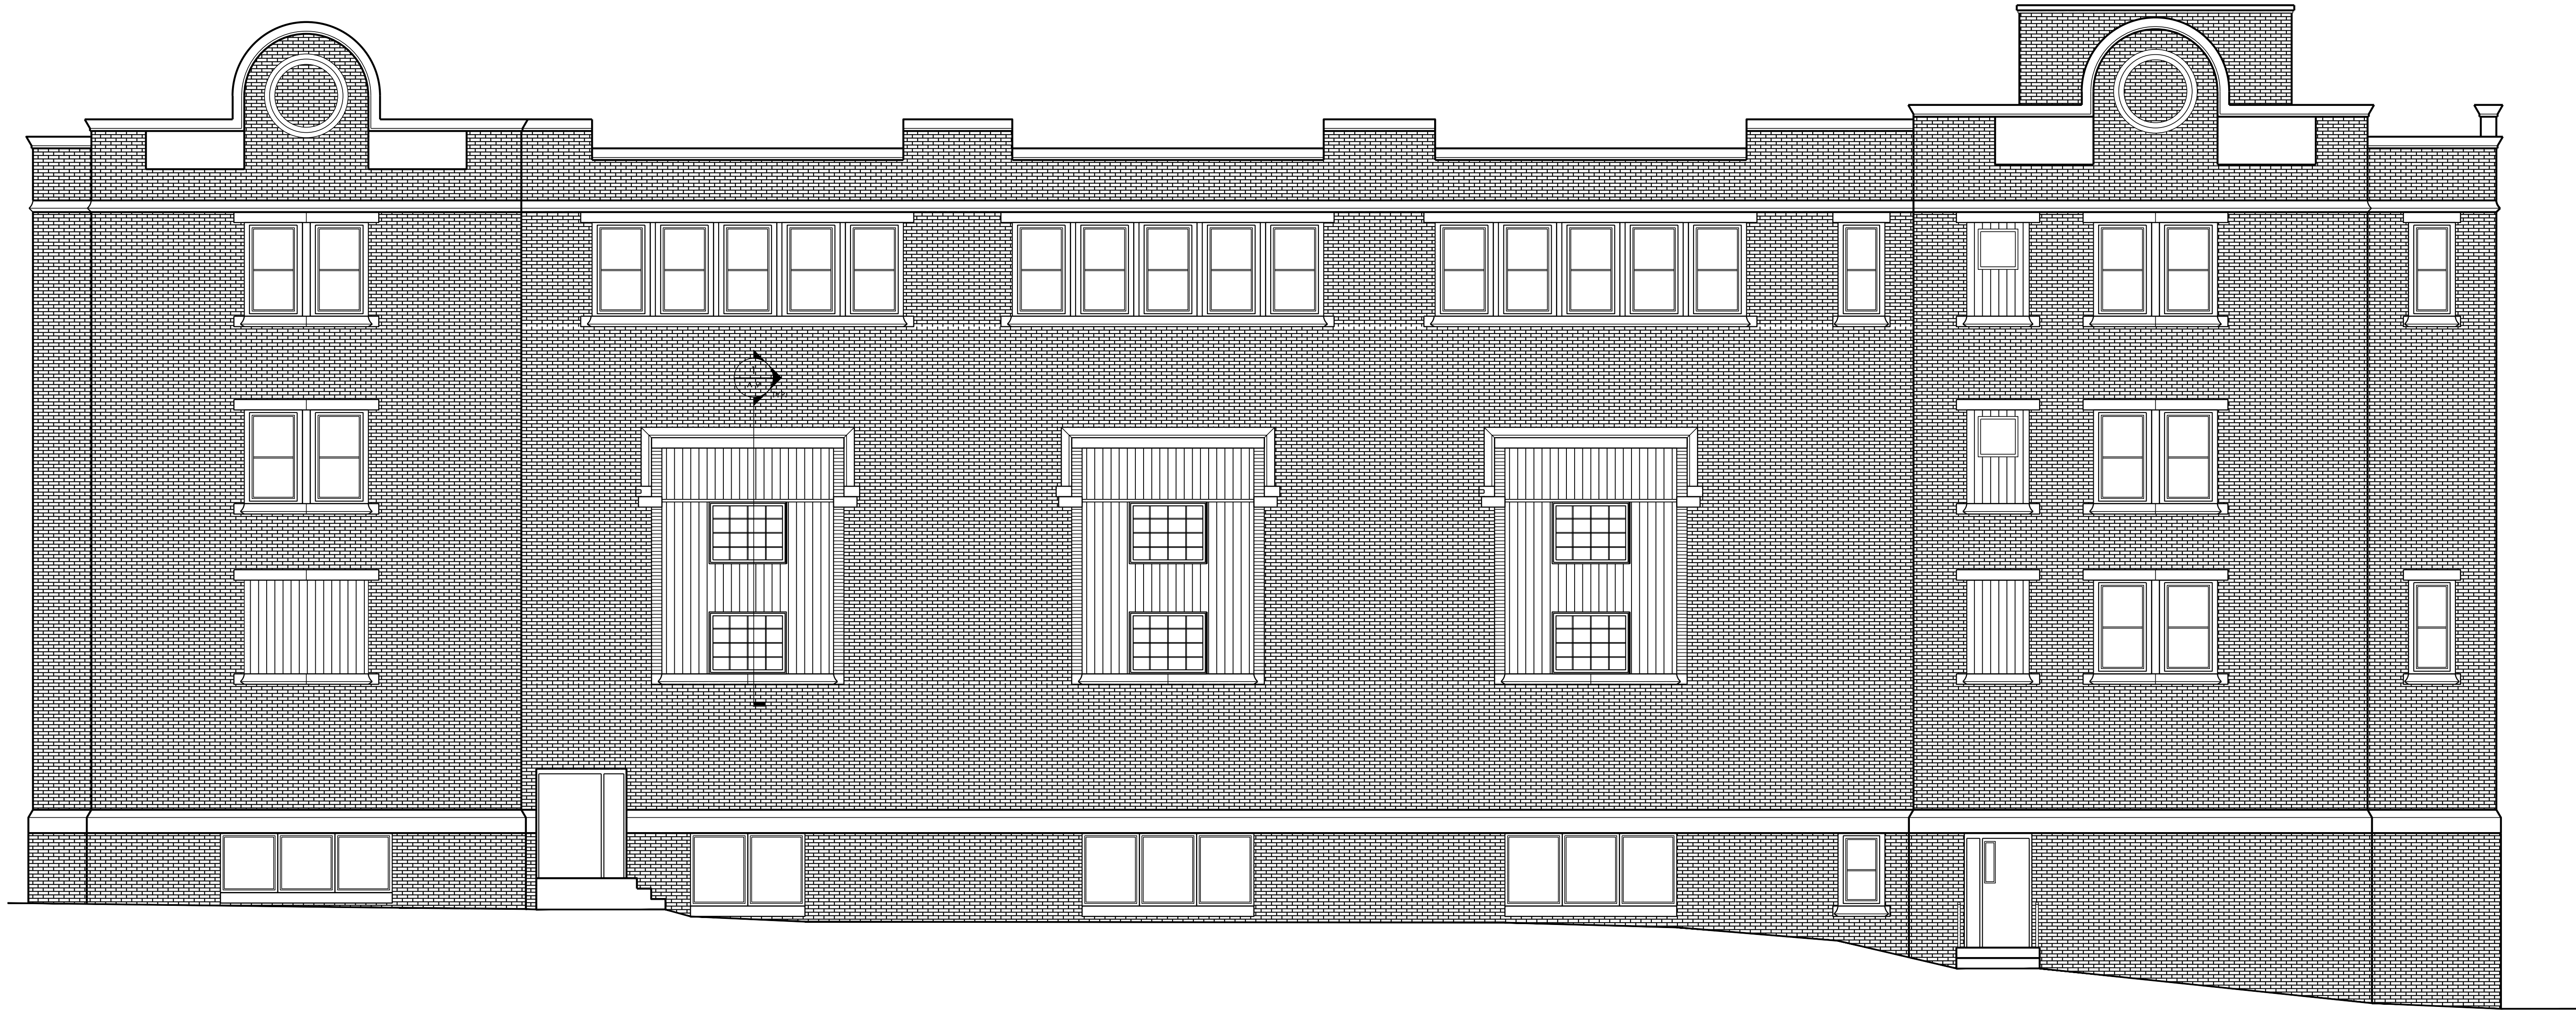

NO.	REVISION	DATE

PROPOSED

BETHLEHEM SCHOOL APARTMENTS

127 EAST 4TH STREET
BETHLEHEM, PA 18015

DATE ISSUED AUGUST 26, 2024
DESIGNED BY TAREK SHEHAB
DRAWN BY TAREK SHEHAB
DRAWING TITLE ARCHITECTURAL RIGHT SIDE ELEVATION